




**SEWER MAIN INSTALLATION
PARALLEL TO WATER MAIN
OR WATER SERVICE LATERAL
(TYP.)**

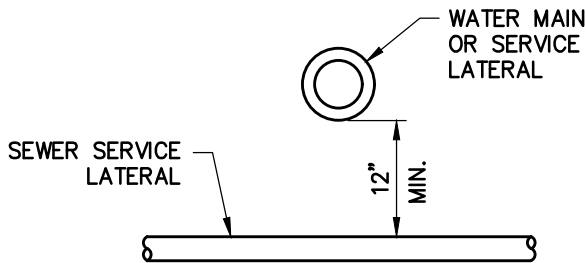


**SEWER SERVICE LATERAL
CROSSING WATER MAIN OR
WATER SERVICE LATERAL
(TYP.)**

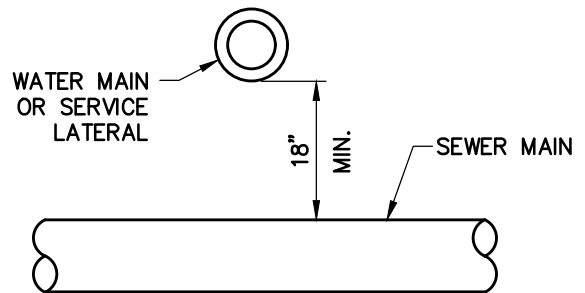

**SEWER MAIN CROSSING WATER
MAIN OR WATER SERVICE LATERAL
(TYP.)**

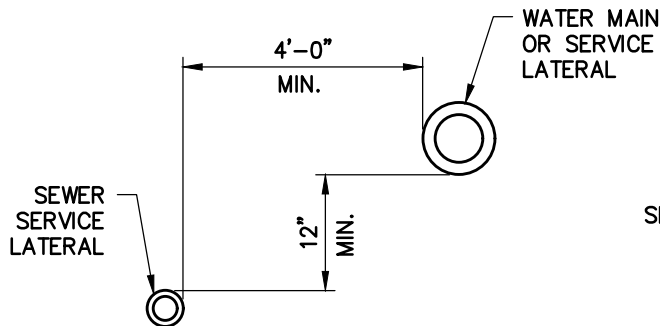


**SEWER SERVICE LATERAL
INSTALLATION PARALLEL TO
WATER MAIN OR WATER
SERVICE LATERAL
(TYP.)**

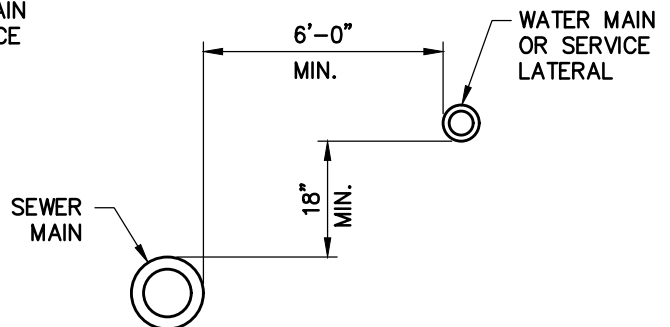

**SEWER MAIN INSTALLATION
PARALLEL TO WATER MAIN OR
WATER SERVICE LATERAL
(ALT.)**

NOTES:

1. INSTALLATION OF WATER, SEWER AND STORM DRAIN MAINS AND LATERALS SHALL BE IN CONFORMANCE WITH NAC 445A.67155 TO NAC 445A.6718 FOR WATER AND SEWER SEPARATION AND CROSSING REQUIREMENTS.
2. WHENEVER POSSIBLE, SEWER LINES AND LATERALS SHALL BE INSTALLED IN SEPARATE TRENCHES IN THE TYPICAL CONFIGURATIONS SHOWN ABOVE. IF NOT THE CONTRACTOR SHALL OBTAIN WRITTEN APPROVAL FROM CITY ENGINEER FOR ANY OTHER CONFIGURATION.

NO.	REVISION	DATE	STANDARD DETAIL FOR PUBLIC WORKS CONSTRUCTION	SECTION
			WATER AND SEWER SEPARATION	CARSON CITY
				DRAWING NO. C-3.1.2
				DATE
				MAR 2022
APPROVED BY: 			3/22	